


ENGINEERING

Modbus TCP Protocol for Nimbus - SLC TWIN PRO2 8-20 kVA, V 1.0

Indice general

MODBUS FUNCTION CODES.

UPS PARAMETERS.

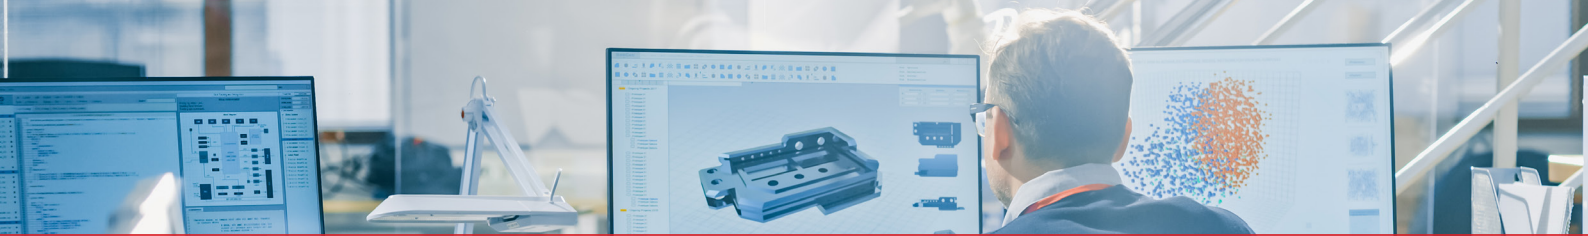

ENGINEERING

Modbus TCP Protocol for Nimbus - SLC TWIN PRO2 8-20 kVA, V 1.0

MODBUS FUNCTION CODES.

The NIMBUS supports the following function codes:

- 01H - Read Coils
- 02H - Read Discrete Inputs
- 03H - Read Holding Registers
- 04H - Read Input Registers
- 05H - Write Single Coil

Please note a UPS must support this type of commands - the currently available function codes depend on the connected UPS. In general, standard UPS systems provide the functions 03H and 04H. The NIMBUS is designed not to distinct between these two functions.

Furthermore, the NIMBUS supports a query speed up to 38400 baud to allow a flexible integration into existing IT environments.

Communication Example:

The following tables contain the general command descriptions and examples with Modbus RTU framing.

Query

SLAVE NO	FUNCTION CODE	ADDRESS OF FIRST WORD TO READ		WORD COUNT		CHECKSUM LRC OR CRC
1 byte	1 byte	High byte	Low byte	High byte	Low byte	1 or 2 byte(s)

Answer

SLAVE NO	FUNCTION CODE	BYTE COUNT	HIGH BYTE OF FIRST WORD	LOW BYTE OF FIRST WORD	BYTES WITH CONTENTS OF N WORDS	CHECKSUM LRC OR CRC
1 byte	1 byte	1 byte	1 byte	1 byte	n * 2 bytes	1 or 2 byte(s)


Read Words (Functions 03h and 04h):

- Example: Read Words, Function 04h

Read one word at address 63h (= 99 decimal):

Query

BYTE	1	2, 3	4, 5	6, 7	8, 9	10, 11	12, 13	14, 15	16	17
Meaning	Leading colon	Slave number	Function code	address of first word to read high byte low byte		word count to read high byte low byte		LRC	Carriage return	line feed LF
HEX	[3A]	[30][31]	[30][34]	[30][30]	[36][33]	[30][30]	[30][31]	[39][37]	[0D]	[0A]

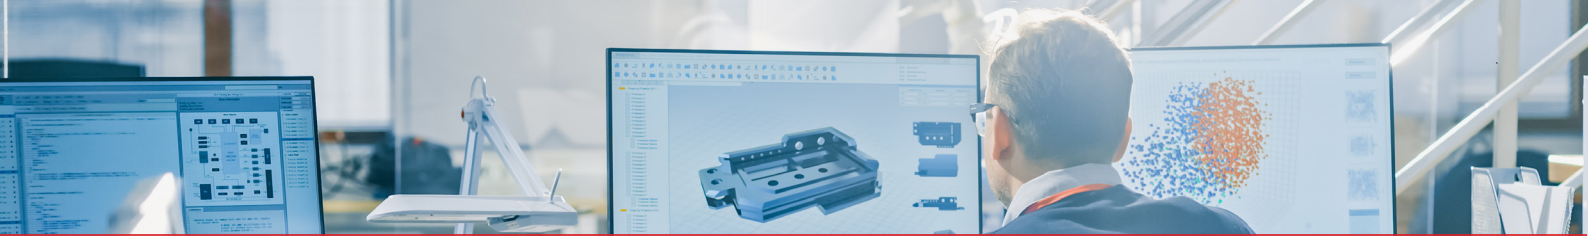

ENGINEERING

Modbus TCP Protocol for Nimbus - SLC TWIN PRO2 8-20 kVA, V 1.0

Answer

BYTE	1	2, 3	4, 5	6, 7	8, 9	10, 11	12, 13	14	15
Meaning	leading colon	Slave number	function code	byte count	contents of the word high byte	LRC low byte	carriage return	line feed LF	
HEX	[3A]	[30][31]	[30][34]	[30][32]	[31][32]	[33][34]	[42][33]	[0D]	[0A]

HEX: Hexadecimal values of the data

→ The word at address contains the value 1234h = 4660 decimal.

Example: Read Words, Function 04h, RTU Mode

Read one word at address 63h (= 99 decimal) (The word at address contains the value 1234h = 4660 decimal.):

Query

BYTE		1	2	3	4	5	6	7	8	
Meaning	silent interval ≥ 3,5 characters	Slave number	function code	address of first word to read high byte low byte		word count to read high byte low byte		CRC low byte	High byte	silent interval ≥ 3.5 characters
RTU		[01]	[04]	[00]	[63]	[00]	[01]	[C1]	[D4]	
HEX										

Answer


BYTE		1	2	3	4	5	6	7	
Meaning	silent interval ≥ 3.5 characters	Slave number	function code	byte count	Contents of the word high byte low byte		CRC low byte high byte		Silent interval ≥ 3.5 characters
RTU		[01]	[04]	[02]	[12]	[34]	[B4]	[47]	
HEX									

Modbus error codes

Excepted broadcast messages, where the master device sends requests to the slave device, the master expects a clear and valid response from the slave he queried. If the answer does not match with expected specifications, the packet will be discarded with a corresponding error message.

There are several possible events that may occur when a slave answers to a master's request:

1. The slave responds accordingly with a data packet that is both, correct and valid.
The master will handle it accordingly.
2. The slave unit does not receive the request the master device sends.
This event occurs, for example, in case of a communication error. From the point of view of the master the request was not answered. As a consequence, the master will assume an appropriate timeout incident.
3. Master or slave will send invalid queries / answers.

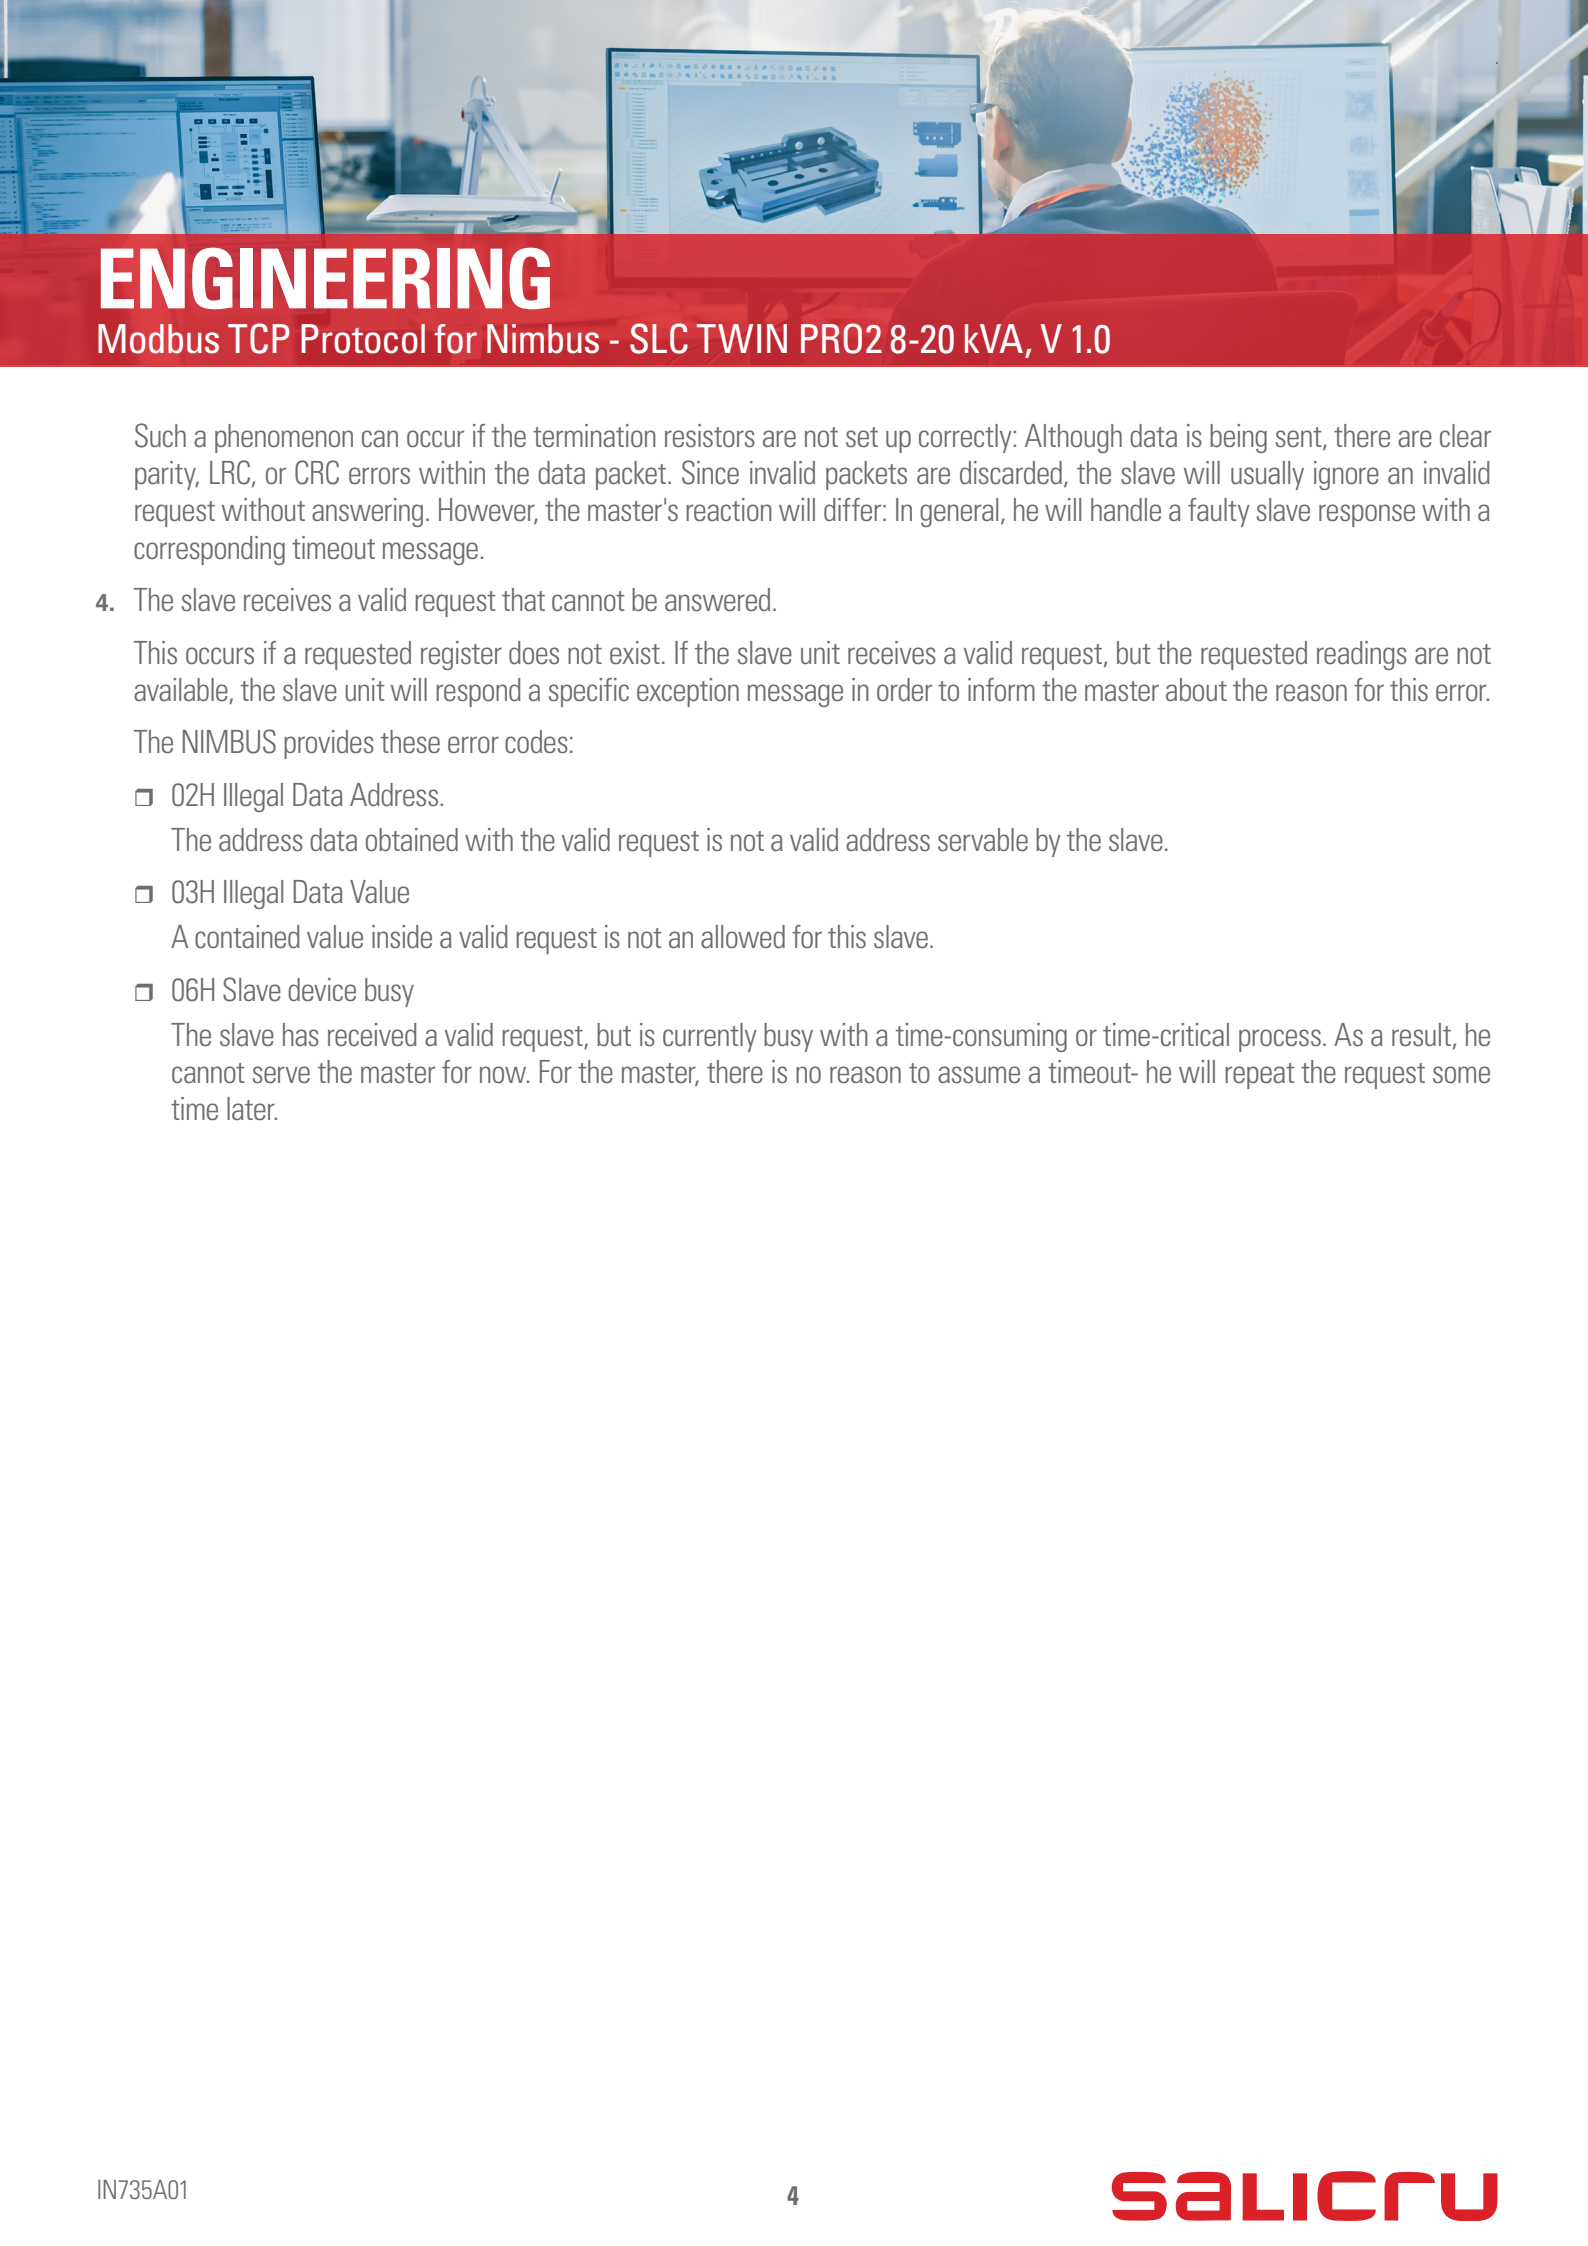

ENGINEERING

Modbus TCP Protocol for Nimbus - SLC TWIN PRO2 8-20 kVA, V 1.0

Such a phenomenon can occur if the termination resistors are not set up correctly: Although data is being sent, there are clear parity, LRC, or CRC errors within the data packet. Since invalid packets are discarded, the slave will usually ignore an invalid request without answering. However, the master's reaction will differ: In general, he will handle a faulty slave response with a corresponding timeout message.

4. The slave receives a valid request that cannot be answered.

This occurs if a requested register does not exist. If the slave unit receives a valid request, but the requested readings are not available, the slave unit will respond a specific exception message in order to inform the master about the reason for this error.

The NIMBUS provides these error codes:

❑ 02H Illegal Data Address.

The address data obtained with the valid request is not a valid address servable by the slave.

❑ 03H Illegal Data Value

A contained value inside a valid request is not an allowed for this slave.

❑ 06H Slave device busy

The slave has received a valid request, but is currently busy with a time-consuming or time-critical process. As a result, he cannot serve the master for now. For the master, there is no reason to assume a timeout- he will repeat the request some time later.

ENGINEERING

Modbus TCP Protocol for Nimbus - SLC TWIN PRO2 8-20 kVA, V 1.0

UPS PARAMETERS.


Please note: The type U/S defines if the answer contains has a mathematical sign(+/-) or not. Type U means unsigend (without a mathematical sign), type S means sigend (with a mathematical sign). The answer may be true or false. Some clients (f.e. MODBUS Poll) use MODBUS addresses with a valid range between 0-65535. Some clients use as the valid range 1-65536, so it may be necessary to add 1 to the address.

type_reg	address_reg	type_cod_reg	num_reg	description_reg	multiplying_factor	units	cloud_sensor_type	cloud_sensor_subtype	sensor_group	backup
r	2	dec	1	Protocol ID	1	---	info	misc	System	false
r	3	dec	1	Protocol address	1	---	internal_data	misc	System	false
r	5	dec	1	UPS model	1	---	info	misc	System	false
r	6	dec	1	UPS type	1	0=Standby/1=Line Interactive ./././././././10=Online	info	misc	System	false
r	7	dec	1	Communication baudrate	1	bit/s	info	misc	System	false
r	9	ascii	2	Neutral loss setting	1	ATO=Temporal/ CHE=Permanent/DIS=Disable	info	misc	System	false
r	11	dec	6	UPS serial number	1	---	info	misc	System	false
r	18	dec	1	DSP1 firmware number	1	---	info	misc	System	false
r	19	dec	1	DSP1 firmware version	1	---	info	misc	System	false
r	21	dec	1	MCU firmware number	1	---	info_cloud	misc	System	false
r	22	dec	1	MCU firmware version	1	---	info	misc	System	false
r	24	dec	1	Input phase	1	./1=Mono Phase/./3=Tri Phase	info_cloud	misc	System	false
r	25	dec	1	Output phase	1	./1=Mono Phase/./3=Tri Phase	info_cloud	misc	System	false
r	26	ascii	1	UPS operating mode	1	P=Power On/S=Standby/ Y=Bypass/L=OnLine/ B=Batteries/T=Battery Test/ F=Fault/E=ECO/C=Frequency Converter/D=Power Off	info_cloud	misc	System	false
r	400	ascii	5	General status of the UPS	1	0=False/1=True	alarm	alarm	Alarm	false
r	405	ascii	1	UPS failure	1	---	alarm	alarm	Alarm	false
r	406	ascii	4	info.ups_fail_status	1	0=False/1=True	alarm	alarm	Alarm	false
r	410	dec	1	Input voltage before fault	0.1	V	data	voltage	Input	false
r	411	dec	1	Input frequency before fault	0.1	Hz	data	frequency	Input	false
r	412	dec	1	Output voltage before fault	0.1	V	data	voltage	Output	false
r	413	dec	1	Output frequency before fault	0.1	Hz	data	frequency	Output	false
r	414	dec	1	Output current before fault	0.1	A	data	current	Output	false
r	415	dec	1	Percentage of charge before failure	1	%	data	load	Output	false
r	416	dec	1	Positive DC bus voltage before fault	0.1	V	data	internal_data	Inverter	false
r	417	dec	1	Negative DC bus voltage before fault	0.1	V	data	internal_data	Inverter	false
r	418	dec	1	Battery voltage before failure	0.1	V	data	voltage	Battery	false
r	419	dec	1	Maximum temperature before failure	0.1	°C	data	internal_data	Other	false

ENGINEERING

Modbus TCP Protocol for Nimbus - SLC TWIN PRO2 8-20 kVA, V 1.0

type_reg	address_reg	type_cod_reg	num_reg	description_reg	multiplying_factor	units	cloud_sensor_type	cloud_sensor_subtype	sensor_group	backup
r	420	ascii	8	Status query warning (1)	1	---	alarm	alarm	Alarm	false
r	428	ascii	3	Status query warning (2)	1	---	alarm	alarm	Alarm	false
r	500	dec	1	Input voltage at L1	0.1	V	data_cloud_plot	voltage	Input	false
r	501	dec	1	Input voltage at L2	0.1	V	data_cloud_plot	voltage	Input	false
r	502	dec	1	Input voltage at L3	0.1	V	data_cloud_plot	voltage	Input	false
r	503	dec	1	Input voltage between phases L1-L2	0.1	V	data_cloud	voltage	Input	false
r	504	dec	1	Input voltage between phases L2-L3	0.1	V	data_cloud	voltage	Input	false
r	505	dec	1	Input voltage between phases L3-L1	0.1	V	data_cloud	voltage	Input	false
r	506	dec	1	Input frequency	0.1	Hz	data_cloud	frequency	Input	false
r	507	dec	1	Output voltage	0.1	V	data_cloud_plot	voltage	Output	false
r	508	dec	1	Output frequency	0.1	Hz	data_cloud	frequency	Output	false
r	509	dec	1	Output current	0.1	A	data_cloud_plot	current	Output	false
r	510	dec	1	Load percentage	1	%	data_cloud	load	Output	false
r	511	dec	1	Maximum load percentage	1	%	data_cloud	load	Output	false
r	512	dec	1	Minimum load percentage	1	%	data_cloud	load	Output	false
r	513	dec	1	Positive DC bus voltage	0.1	V	data	internal_data	Inverter	false
r	514	dec	1	Negative DC bus voltage	0.1	V	data	internal_data	Inverter	false
r	515	dec	1	Positive battery voltage	0.1	V	data_cloud	voltage	Battery	false
r	516	dec	1	Negative battery voltage	0.1	V	internal_data_cloud	voltage	Battery	false
r	518	dec	1	Number of batteries in parallel	1	---	info	misc	Battery	false
r	519	dec	1	Battery capacity	1	%	data_cloud	load	Battery	false
r	520	dec	1	Remaining backup time	1	min	data_cloud	misc	Battery	false
r	521	dec	1	Inverter temperature	0.1	°C	data_cloud	internal_data	Other	false
r	522	dec	1	PFC L1 temperature	0.1	°C	data_cloud	internal_data	Other	false
r	523	dec	1	PFC L2 temperature	0.1	°C	data	internal_data	Other	false
r	524	dec	1	PFC L3 temperature	0.1	°C	data	internal_data	Other	false
r	525	dec	1	Maximum temperature	0.1	°C	data_cloud	data	Other	false
r	700	dec	1	Rated output power	1	VA	info	power	Output	false
r	701	dec	1	Nominal output power factor	1	---	info	misc	Output	false
r	702	dec	1	Nominal input voltage	1	V	info	voltage	Input	false
r	703	dec	1	Nominal output voltage	1	V	info	voltage	Output	false
r	704	dec	1	Number of units in the battery string (Semi-Bus)	1	---	data	misc	Battery	false
r	705	dec	1	Nominal battery voltage	0.1	V	info	voltage	Battery	false
r	706	dec	1	Nominal output frequency	0.1	Hz	info	frequency	Output	false
r	707	dec	1	Nominal battery bus voltage	0.1	V	info	voltage	Battery	false
r	708	dec	1	Rated output current	0.1	A	info	current	Output	false

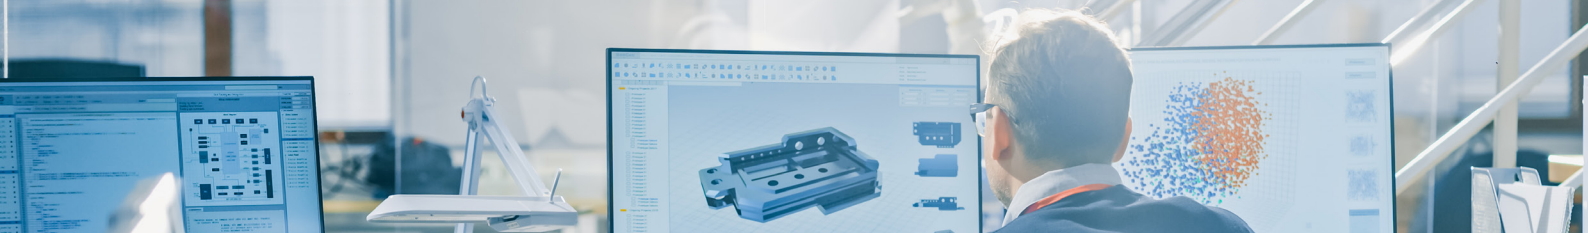

ENGINEERING

Modbus TCP Protocol for Nimbus - SLC TWIN PRO2 8-20 kVA, V 1.0

type_reg	address_reg	type_cod_reg	num_reg	description_reg	multiplying_factor	units	cloud_sensor_type	cloud_sensor_subtype	sensor_group	backup
r	1000	dec	1	Enable / disable all audible alarms	1	0=Disable/1=Enable	info	misc	Flags	false
r	1001	dec	1	Enable / Disable Audible Alarm Battery Mode	1	0=Disable/1=Enable	info	misc	Flags	false
r	1002	dec	1	Enable / disable battery disconnected audible warning	1	0=Disable/1=Enable	info	misc	Flags	false
r	1003	dec	1	Enable / disable high efficiency mode (ECO mode)	1	0=Disable/1=Enable	info	misc	Flags	false
r	1004	dec	1	Enable / disable forbidden bypass	1	0=Disable/1=Enable	info	misc	Flags	false
r	1005	dec	1	Enable / disable inverter clear function	1	0=Disable/1=Enable	info	misc	Flags	false
r	1006	dec	1	Enable / disable bypass function when UPS shuts down	1	0=Disable/1=Enable	info	misc	Flags	false
r	1007	dec	1	Enable / Disable Static Bypass Transfer	1	0=Disable/1=Enable	info	misc	Flags	false
r	1008	dec	1	Enable / disable audible bypass warning	1	0=Disable/1=Enable	info	misc	Flags	false
r	1009	dec	1	Enable / disable auto reboot	1	0=Disable/1=Enable	info	misc	Flags	false
r	1010	dec	1	Enable / disable battery discharge protection	1	0=Disable/1=Enable	info	misc	Flags	false
r	1011	dec	1	Enable / disable low battery protection	1	0=Disable/1=Enable	info	misc	Flags	false
r	1012	dec	1	Enable / disable converter mode	1	0=Disable/1=Enable	info	misc	Flags	false
r	1013	dec	1	Enable / disable phase rotation alarm	1	0=Disable/1=Enable	info	misc	Flags	false
r	1200	dec	1	Battery Output Voltage Calibration	1	V	info	misc	Calibrations	false
r	1201	dec	1	Output voltage calibration	1	V	info	misc	Calibrations	false
r	1202	dec	1	DC bus voltage calibration	1	V	info	misc	Calibrations	false
r	1203	dec	1	DC bus positive voltage calibration	1	V	info	misc	Calibrations	false
r	1204	dec	1	DC bus negative voltage calibration	1	V	info	misc	Calibrations	false
r	1210	dec	1	Bypass voltage high range	0.1	V	info_cloud	misc	Calibrations	false
r	1211	dec	1	Low margin of bypass voltage	0.1	V	info_cloud	misc	Calibrations	false
r	1212	dec	1	Bypass frequency high range	0.1	Hz	info_cloud	misc	Calibrations	false
r	1213	dec	1	Low margin of bypass frequency	0.1	Hz	info_cloud	misc	Calibrations	false
r	1214	dec	1	High voltage range in ECO mode	1	V	info	misc	Calibrations	false
r	1215	dec	1	Low voltage range in ECO mode	1	V	info	misc	Calibrations	false