
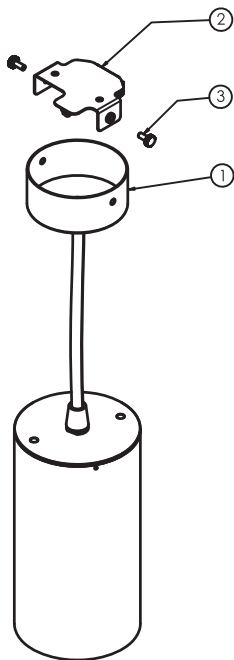


For Installation of Brisbane Pendant luminaires Model. BRB-95001, BRB-95011, BRB-95021, BRB-95031

Product drawing (dimensions)

CE IP20 CLASS I

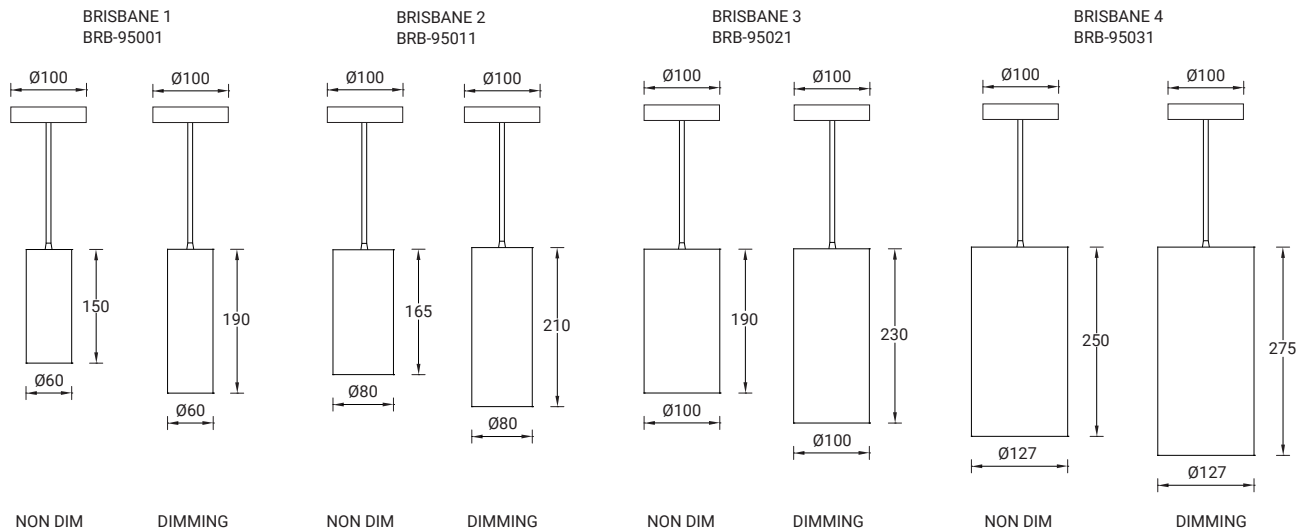

IMPORTANT NOTES : READ ALL INSTRUCTIONS THOROUGHLY AND CAREFULLY PRIOR TO INSTALL OF FITTING AND RETAIN FOR FUTURE REFERENCE

- 1 - INSTALLATION MUST BE BY A REGISTERED ELECTRICAL CONTRACTOR.
- 2 - ENSURE ELECTRICAL POWER SUPPLY IS SWITCHED OFF BEFORE AND DURING THE INSTALLATION.
- 3 - REMOVE FIXING BRACKET (2) BY UNSCREW FIXING KNOB (3).
- 4 - FIX FIXING BRACKET TO CEILING. FIXING SCREWS SUPPLIED BY OTHER.
- 5 - CONNECT MAIN SUPPLY TO TERMINAL BLOCK.
KEEP INCOMING CABLE AS SHORT AS POSSIBLE.
- 6 - REPLACE CEILING ROSE (1) AND SECURE WITH FIXING KNOB (3).

- **LIGMAN standard products are supplied with the control gear 220-240V 50/60Hz.**
The control gear for other voltages and frequencies is available upon request, please consult us for more details.
- **LIGMAN luminares are designed to conform IEC 60598 2-1 standard.**
Technical amendments and modifications techniques reserved.

Ligman Lighting

Europe Headquarters
Ligman Europe s.r.o.
VGP Park Usti nad Labem, P2 120,
40317 Prestanov
Czech Republic
Tel. +420 477 071 500
sales.cz@ligman.com

www.ligman.com

M BRB-95001/17/10/20/REV.0
1/1

Thailand Headquarters
Ligman Lighting Co., Ltd.
17/2 Moo 4, Monthong,
Bangnampreaw,
24150, Chachoengsao
Tel : +66 33 026 082
info@ligman.com

FM-TS-13-1/13-05-2563/REV.6